

Reliance™-SS 2 pc. Horizontal Expansion Joint & Back Pan INSTALLATION AND GLAZING MANUAL

RELIANCE™-SS 2-PC. EXPANSION HORIZONTAL & BACKPAN INSTALLATION MANUAL TABLE OF CONTENTS

General Information	Page 3
Product Use	Page 3
Protection and Storage	Page 4
Check Material	Page 4
Field Conditions	Page 4
Cleaning Materials	Page 4
Expansion Joints	Page 4
Suggestions for Improving System Thermal Performance	Page 5
Stack Joint Fabrication	Page 6
Retainer Fabrication	Page 7
Splice Installation	Page 8
Stack Horizontal Assembly	Pages 9 -11
Unit Installation	
Stack Gasket Installation	Page 13-14
WW-259 Interior Trim Fabrication	Page 15
Back Pan Installation	Page 16-18
Parts List	Page 19

RELIANCE™-SS 2-PC. EXPANSION HORIZONTAL & BACKPAN INSTALLATION MANUAL GENERAL INFORMATION

PRODUCT USE

The **Reliance™-SS** curtain wall system is intended for installation by glazing professionals with appropriate experience. Subcontractors without experience should employ a qualified person to provide field instruction and project management.

Oldcastle BuildingEnvelope® does not control the application or selection of its product configurations, sealant or glazing material and assumes no responsibility thereof. It is the responsibility of the owner, architect and installer to make these selections in strict compliance with applicable laws and building codes.

Consult sealant manufacturer for review and recommendation of sealant application. Follow sealant manufacturer's recommendations and literature for proper installation.

The air and water performance of the **Reliance™-SS** curtain wall system is directly related to the completeness and integrity of the installation process. To ensure top performance for this system, particular attention should be given the following procedures:

- 1. Surfaces to be sealed should be cleaned with isopropyl alcohol or solvent and dried as recommended by sealant manufacturer to remove all dirt and cutting oils. Sealant at shear blocks should be a minimum 3/16" diameter nominal placed completely around the top, face and bottom of the shear block without gaps in the sealant. Exposed surfaces should be cleaned after installing the horizontal. Inspect joint for complete sealant contact, especially where the horizontal meets the face of the vertical member. Repair joint as required.
- 2. The interior glazing gasket should be installed so as to avoid stretching, buckles or tears. Corners must be cut square, sealed and butted together. To avoid damage to gasket and corner joints during glazing, glass should be level and straight during installation.
- 3. Vertical movement of mullion at intermediate floors requires special expansion joints and glazing materials. See page 12 for details which permit 1/2" movement. For designs and applications that may require greater movement or special considerations please contact your local Oldcastle BuildingEnvelope® facility.

Variations on the details shown are inevitable and are not the responsibility of Oldcastle BuildingEnvelope® when drawn by others. Oldcastle BuildingEnvelope® strongly encourages its customers to utilize Oldcastle BuildingEnvelope® supplied calculations and shop drawings.

For Structural Silicone Glazing applications, the stress on the silicone should not exceed 20 PSI. Consult sealant manufacturer for specific applications to ensure proper loading on silicone joint. Alternate spacer gaskets are available to accommodate larger sealant contact widths. Consult your nearest Oldcastle BuildingEnvelope® facility for assistance.

Consult glass manufacturer for correct setting block location and length for glass sizes in excess of 40 sq.ft.

PROTECTION AND STORAGE

Handle all material carefully. Do not drop from the truck. Stack with adequate separation so the material will not rub together. Store material off the ground, protecting against the elements and other construction hazards by using a well ventilated covering. Remove material from package if wet or located in a damp area. For further guidelines consult AAMA publication CW-10 "Care and Handling of Architectural Aluminum From Shop to Site."

RELIANCE™-SS 2-PC. EXPANSION HORIZONTAL & BACKPAN INSTALLATION MANUAL GENERAL INFORMATION

CHECK MATERIAL

Check glass dimensions for overall size as well as thickness. Oldcastle BuildingEnvelope cannot be held responsible for gaskets that are not water tight due to extreme glass tolerances.

Check all material upon arrival at job site for quality and to determine any shipping damage.

Using the contract documents, completely check the surrounding conditions that will receive your materials. Notify the general contractor by letter of any discrepancies before proceeding with the work. Failure to do so constitutes acceptance of work by other trades.

Check shop drawings, installation instructions, architectural drawings and shipping lists to become familiar with the project. The shop drawings take precedence and include specific details for the project. The installation instructions are of a general nature and cover the most common conditions. Due to varying job conditions all sealant used must be approved by the sealant manufacturer to insure it will perform per the conditions shown on the instructions and shop drawings. The sealant must be compatible with all surfaces in which adhesion is required, including other sealant surfaces. Use primers where directed by sealant manufacturer. Properly store sealant at the recommended temperatures and check sealant for remainder of shelf life before using.

FIELD CONDITIONS

All material to be installed must be plumb, level and true. Aluminum to be placed in direct contact with masonry or incompatible material should be isolated with a heavy coat of zinc rich, bituminous paint or non-metallic material.

After sealant is set and a representative amount of the wall has been glazed (250 square feet or more), run a water hose test in accordance with AAMA 501.2 specifications to check installation. On large projects the hose test should be repeated during the glazing operation.

CLEANING MATERIALS

Cement, plaster terrazzo, alkaline and acid based materials used to clean masonry are very harmful to finishes. Any residue should be removed with water and mild soap immediately or permanent staining will occur. A spot test is recommended before any cleaning agent is used. Refer to the **Architectural Finish Guide** in the Detail Catalog.

EXPANSION JOINTS

Expansion joints and perimeter joints shown in these instructions and in the shop drawings are shown at nominal size. Actual dimensions may vary due to perimeter conditions and/or differences in metal temperature between the time of fabrication and the time of installation. For example, a 12 foot unrestrained length of aluminum can expand or contract 3/32" over a temperature change of 50° F. Any movement potential should be accounted for at the time of the installation.


RELIANCE™-SS 2-PC. EXPANSION HORIZONTAL & BACKPAN INSTALLATION MANUAL GENERAL INFORMATION

SUGGESTIONS FOR IMPROVING SYSTEM THERMAL PERFORMANCE


To maintain or improve your wall installation the following items should be considered.

- A. Blinds or drapes prevent warm air from adequately flowing over the window surface.
- B. Warm air ventilators too far from the window will not adequately wash the window with air to prevent condensation.
- C. In extreme conditions the fan of the heating system should not cycle on and off, but should run continuously.
- D. Some heating systems have a water injection feature that can raise humidity levels. The higher the humidity levels the more likely condensation or frost will form. Raising the temperature and reducing humidity will usually solve the problem.
- E. On rare occasions an extremely cold storm may cause frost to appear on the glass framing. A space heater and electric fan blowing along the plane of the window wall can reduce or eliminate this temporary condition.

- 6.1 Stack horizontal installation may be used when movement greater than 1/4" is expected. This section may be used to accommodate up to a maximum of 3/4".
- 6.2 Notch tongue of upper mullion 31/32" and lower mullion 15/16" as shown in **FIGURE 55**. Notch flush with face of mullion to allow installation of WW- 257 & WW-258 expansion joint gasket retainers.
- 6.3 Drill mullions using "F" (.257Ø) drill bit. Upper mullion may use either standard WW-442 or WW-542 horizontal or WW- 483 or WW-583 at exposed expansion conditions. Lower mullion fabricated for WW-484 or WW-594 horizontals. **See FIGURE 55**.

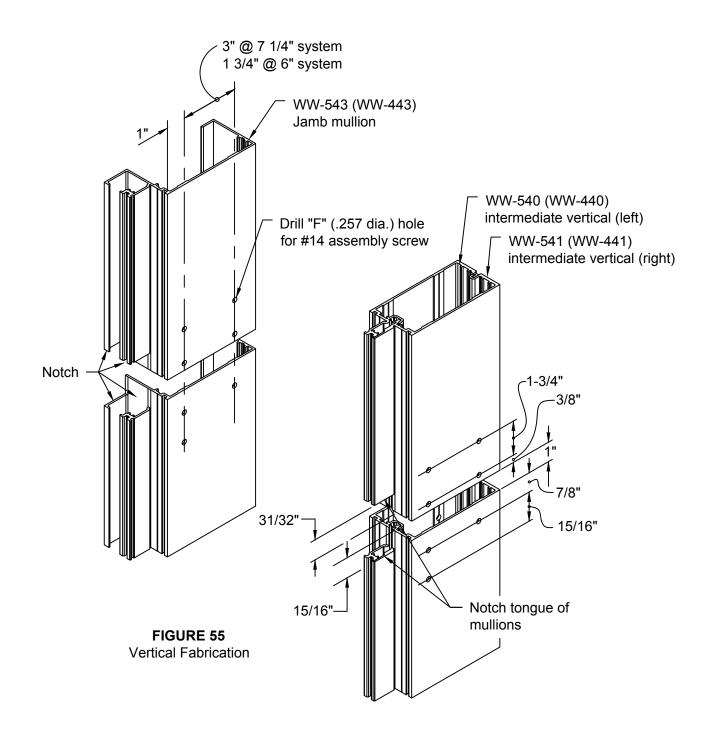

- 6.4 Bellows gasket retainers, WW-257 & WW-258 will be fabricated to run from mull center to mull center except at jambs. These will be cut to extend full width of jamb mullion. A 1/4" joint will be located between retainers at each intermediate mullion. Retainers will be cut Day Light Opening plus 2-1/2" at jambs and DLO plus 1-1/8" at each intermediate vertical. WW-257 will be notched to clear mullion as shown in FIGURE 56. WW-258 will be notched to clear mullions as shown in FIGURE 57 below. Notch 2-9/16" at Jambs and 1-3/16" at Intermediate Vertical Mullions.
- 6.5 WW-257 upper gasket retainer will be square cut typical, miter as required at corners. Drill #11 (.191) holes at 12" on center. See **FIGURE 56**
- 6.6 WW-258 lower gasket retainer will be square cut typical, miter as required at corners. Drill #11 (.191) holes at 12" on center for attachment. 5/16" dia. weep holes must also be drilled in upper channel at centerline of day light opening. See **FIGURE 57**

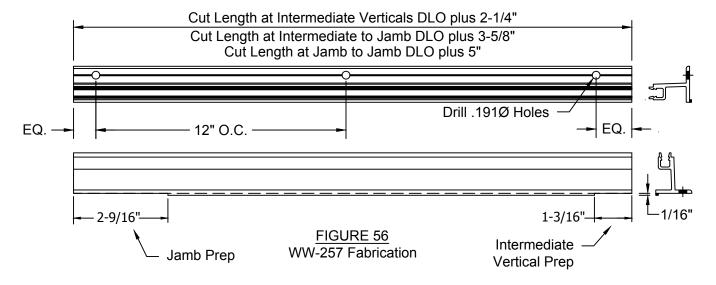



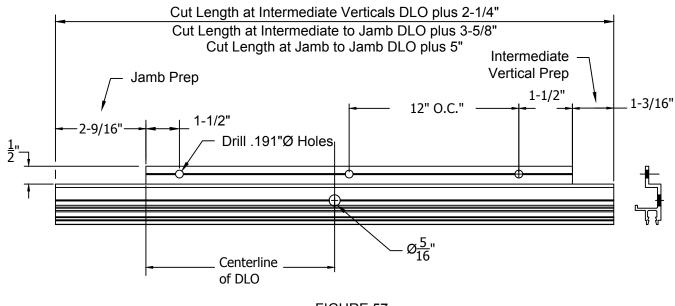


FIGURE 57 WW-258 Fabrication

6.7 Install splices in top of lower mullion assemblies. Splices are 8" long and will be inserted into mullion 4" and attached using (2) FS-322 (#12-14 x 1" HWH Drill-Flex). **See FIGURE 58**If project configuration does not allow for splice installation as shown below, reference **FIGURE 10**, **page 10** of Reliance-SS Installation Manual for alternate splice install.

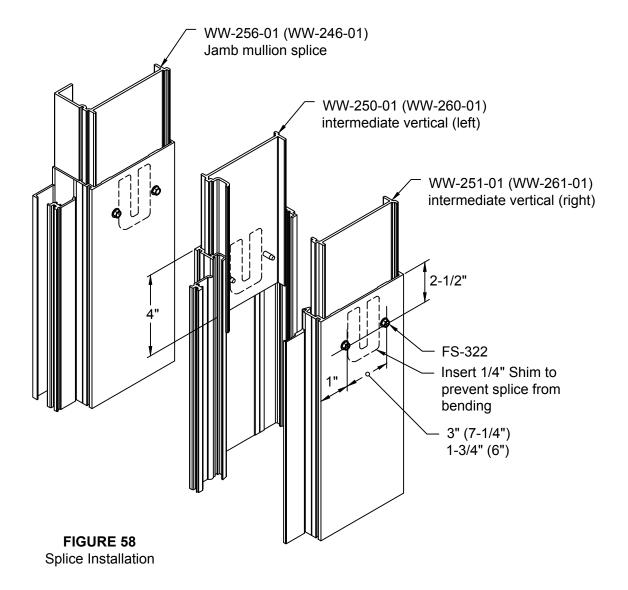


6.8 Assemble each frame with stack horizontals at top or bottom as shown in figure below. Lower section will be assembled with WW-584 (WW-484) horizontal located at top of unit, back leg of horizontal will be located flush with top of lower mullion. Upper frame section will use either typical WW-542 (WW-442) intermediate horizontal at bottom of assembly or for vision areas may use WW-583 (WW-483) horizontal with WW-259 snap-on interior trim. All horizontals will be attached to vertical mullions using FS-8 (#14 x 1 HHSTS). **See FIGURE 59**

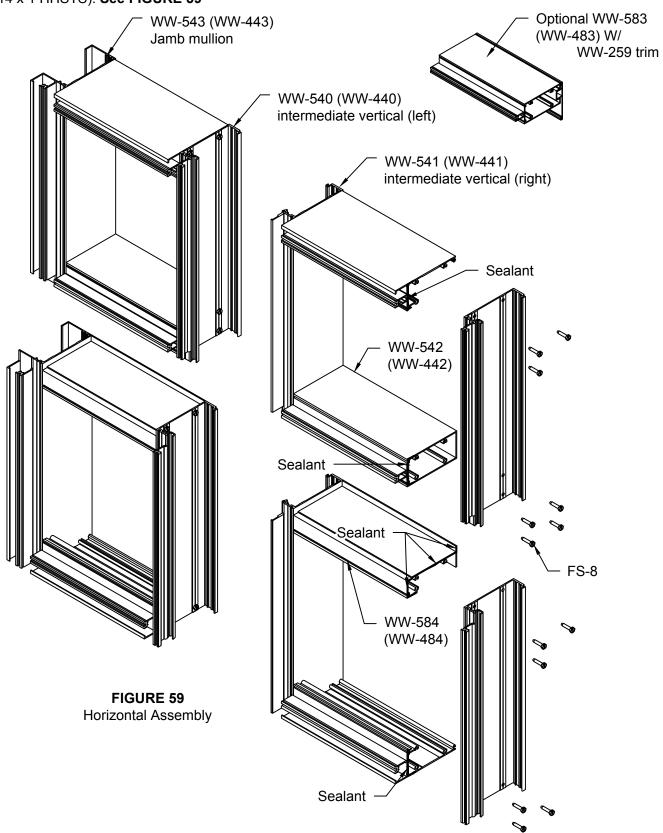



1-866-OLDCASTLE (653-2278)

- 6.9 Install WW- 258 lower gasket retainer to face of horizontal. Bed in continuous bead of sealant and cap seal all fasteners. A 1/4" joint will be located at mull center lines. Attach with FS-13 (#10 x 1" PPH Tek) at 12" on center. **See FIGURE 60**
- 6.10 Install HP-1004 baffles, held in place using SPW-295 baffle retainer. Apply a small amount of sealant to back edge of SPW-295 to hold in place during shipment. Seal ends of horizontal to vertical mullions as shown in **FIGURE 60**. Assembly and sealing of gasket retainer should be performed as part of shop assembly of screw spline frames.

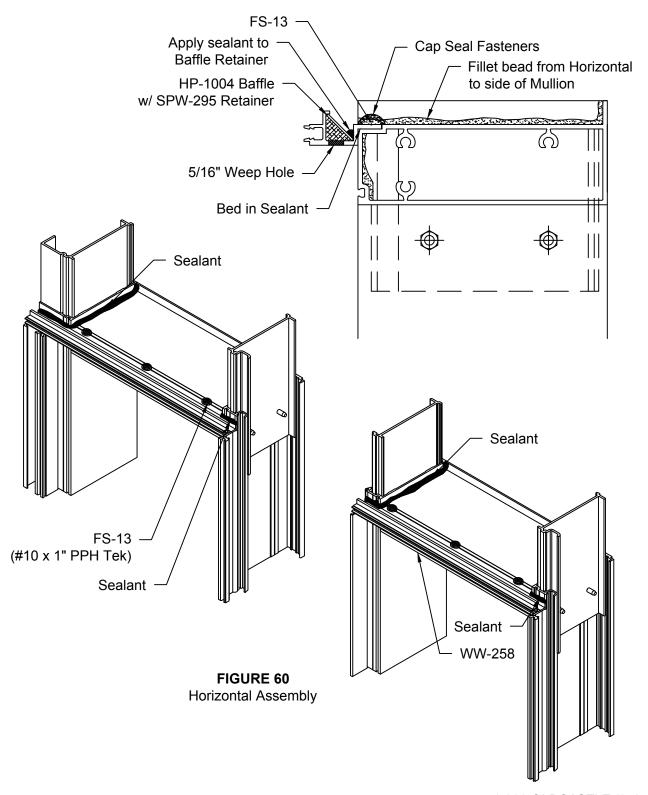


6.11 Install WW- 257 upper gasket retainer to face of horizontal. Bed in continuous bead of sealant and cap seal all fasteners. A 1/4" joint will be located at mull center lines. Attach with FS-13 (#10 x 1" PPH Tek) at 12" on center. **See FIGURE 61**

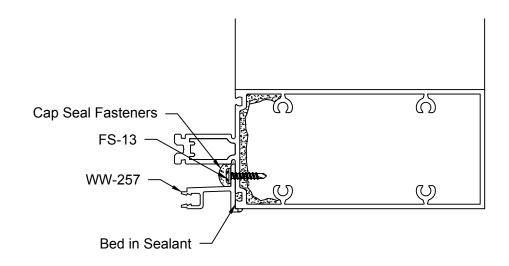


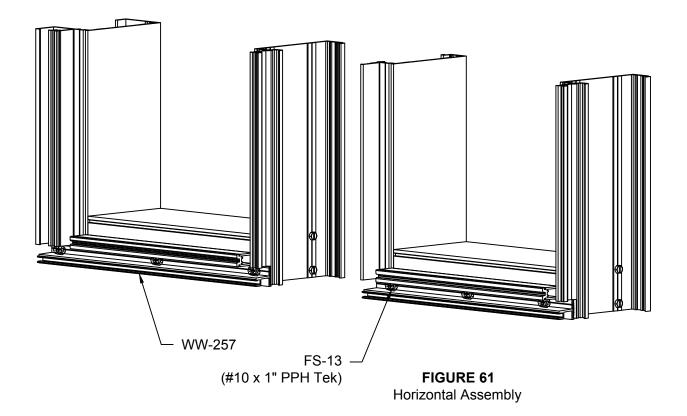


6.12 Follow standard Reliance-SS wall installation procedures as shown in Frame Installation and Glazing sections of this manual.

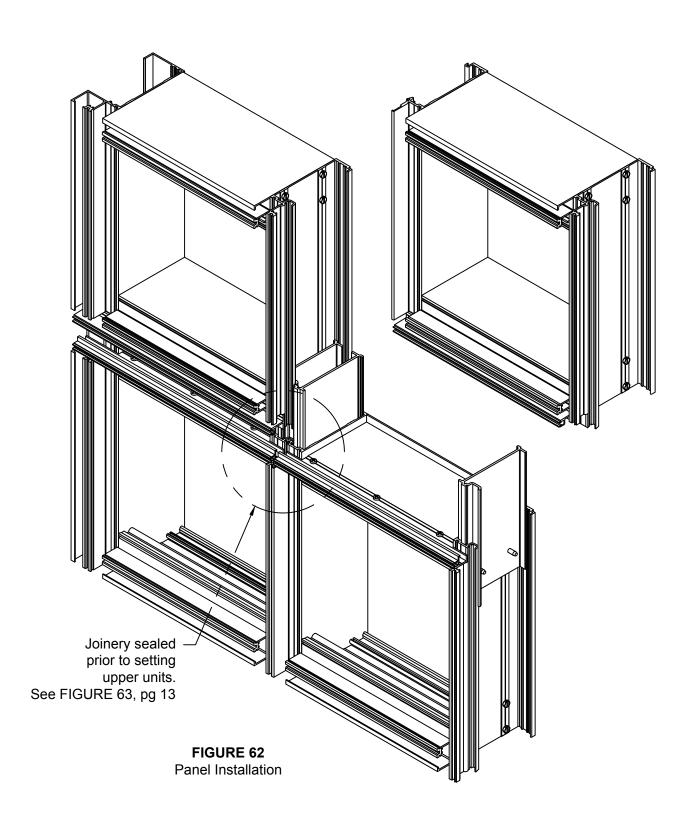


- 6.13 After Reliance-SS framing is installed, install 4" long strips of Silicone Sheet to WW-257 and WW-258 retainers at center line of each vertical mullion. Sheet to be bed in sealant and tooled to form a splice connection. Install Silicone Sheet and sealant at WW-258 in lower unit prior to installing unit above. See FIGURE 63
- 6.14 Gasket race of WW-257 to be filled with continuous bead of sealant and GP-144 gasket inserted into races for WW-257 and WW-258. Leave ends of gasket loose at jambs or corners and set once molded jamb or corner gaskets are installed. See FIGURE 64
- 6.15 Install GP-144-01 jamb sleeve (corner gasket simliar) by sealing WW-257 gasket race, sealing end flap and installing onto mullion and mull splice. Once in place, run bead of sealant across splice section of jamb gasket. Install GP-144 gasket over jamb splice and then run exterior bead of sealant over splice area to create water tight seal. See FIGURE 65

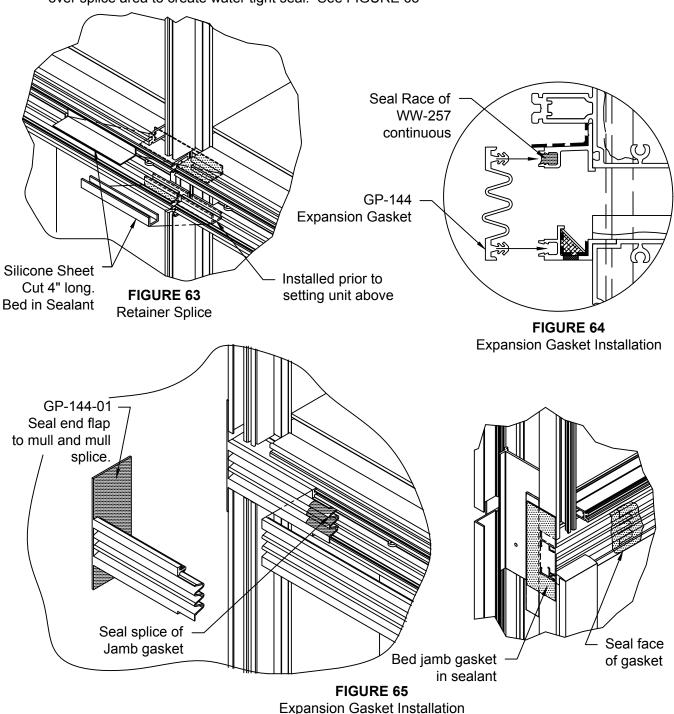


- 6.16 Glaze Reliance-SS per instructions in glazing section of this manual.
- 6.17 Structural Silicone seal is required at top of glass of lower units. This seal must extend forward to cover top of glass. Insert backer rod and seal face of glass to lower side of WW-258 gasket retainer. See FIGURE 66. Do not obstruct weep hole in WW-258 gasket retainer.
- 6.18 Face caps for lower units will be cut Mullion Length minus 1/2". Pressure plate Mullion Length minus 3/4". Upper unit will cut per standard Reliance-SS instructions page 4. Multi span will repeat cut lengths for lower units as needed.
- 6.19 Once pressure plates and face caps are installed. Top side of face cap will have backer rod inserted into opening and seallant applied to seal pressure plate and cap. See FIGURE 67.

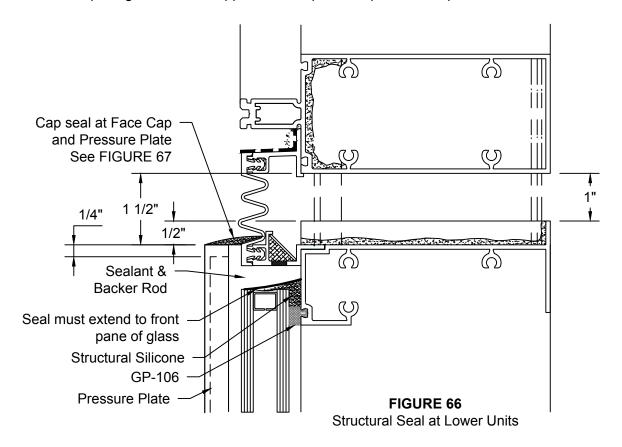


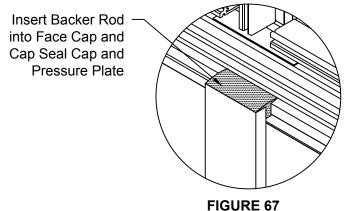


Face Cap / Pressure Plate Seal


6.20 When using the optional WW-583 (WW-483) upper horizontal a WW-259 interior snap on cover will be required. The cover must be notched to clear jamb mullions and intermediate mullions. Ends of cover will be notched 3" at jambs to extend to edge of jamb. If cover is ran to cross vertical mullions then a 3" notch will also be fabricated at these locations. Where the cover needs to be spliced at intermediate mullions the notch will be 1-1/2" long and cover will be cut mullion centerline minus 1/16" to form a 1/8" joint. See FIGURE 68 below for fabrication and FIGURE 69 for butt joint.

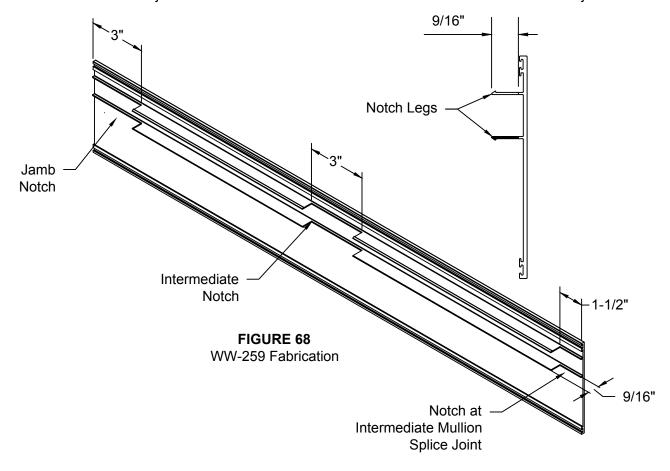


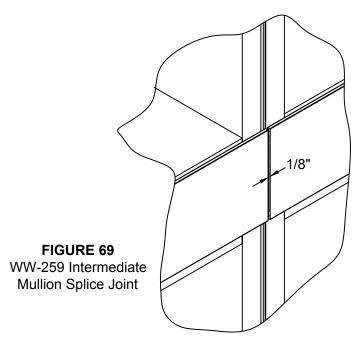


- 6.21 When installing back pans into Reliance™ -SS, use the WW-509 (WW-409) horizontal at top and bottom of back pan areas. These will have 5/16" vent holes drilled into guttered area at 1/8 points. Each vent location to be baffled using a HP-1004 baffle held in place with an SPW-295 retainer. See **FIGURE 70**.
- 6.22 The back pan is installed at back of horizontal from exterior and fully sealed around perimeter, cap seal fasteners and marry seal with seals at verticals to horizontals connections **See FIGURE 71**, page 17.
- 6.23 Install shadow box attachment angles around perimeter as shown in **FIGURE 72**, **page 17**. Bed angles in sealant and cap seal attachment fasteners. Note: angles are only required for shadow box application.
- 6.24 Insulation will be placed into cavity. See **FIGURE 72**, page 17.
- 6.25 Shadow box is installed onto attachment angles. Note: The shadow box is not required to be sealed if back pan and horizontals are sealed as described above. See **FIGURE 73,page 18**.
- 6.26 Reference Reliance-SS Installation and Glazing Manual, pages 21 & 22 for glazing information.

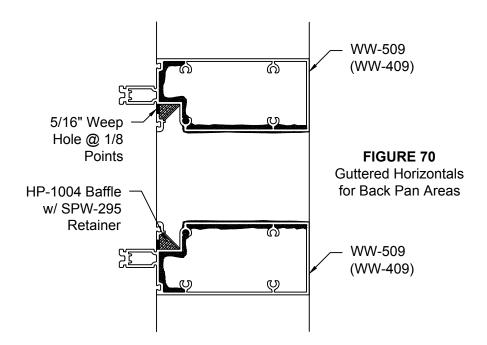

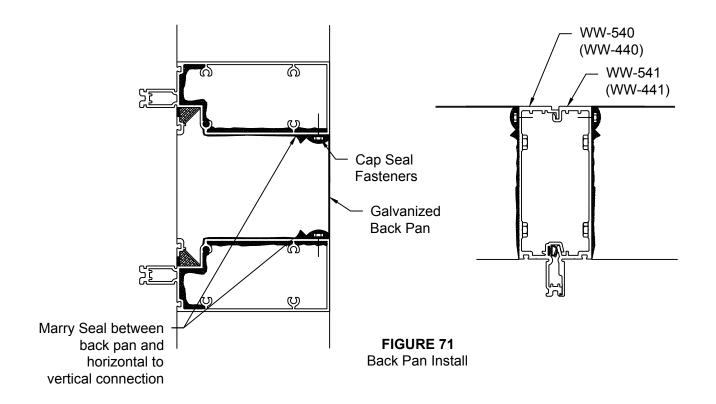

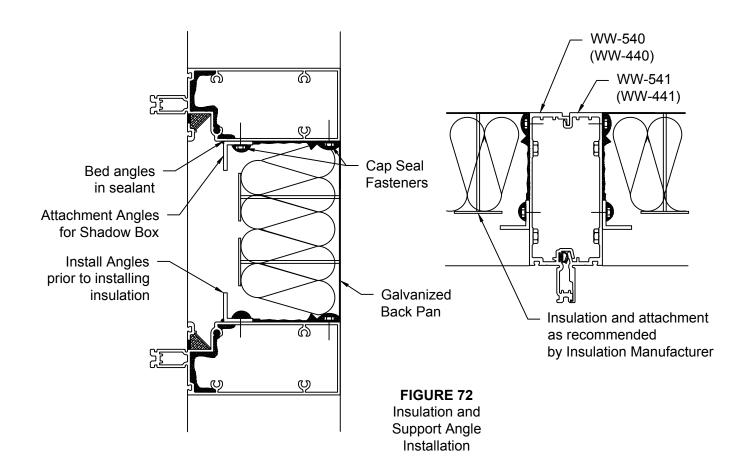

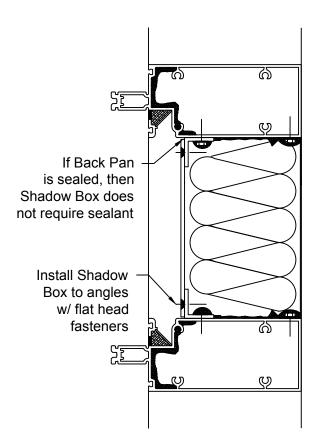




FIGURE 73
Back Pan Horizontal
& Vertical Details

PARTS LIST

EXPANSION STACK & ACCESSORIES

WW-483	Horizontal - Upper Stack Vision Area 6"
WW-484	Horizontal - Lower Stack 6"
WW-583	Horizontal - Upper Stack Vision Area 7-1/4"
WW-584	Horizontal - Lower Stack 7-1/4"
WW-409	Guttered Horizontal 6"
WW-509	Guttered Horizontal 7-1/4"
되 WW-257	Upper Expansion Gasket Retainer
€ WW-258	Lower Expansion Gasket Retainer
WW-259	Interior Trim for WW-483 & WW-583
HP-1004	Weep Baffle for WW-258
SPW-295	Baffle Retainer
L AN-2	Shadow Box Attachment Angle

EXPANSION STACK & ACCESSORIES

<u> </u>		
近小小连 GP-144	Expansion Gasket	
GP-144-01	Expansion Gasket for Jamb Mullion	
GP-144-02	Expansion Gasket for O.S.90 Corners	
GP-144-03	Expansion Gasket for I.S.90 Corners	
WW-250-01	Splice Sleeve for WW-540	
₩W-251-01	Splice Sleeve for WW-541	
WW-260-01	Splice Sleeve for WW-440	
∜———↓ WW-261-01	Splice Sleeve for WW-441	
WW-246-01	Splice Sleeve for WW-443	
WW-256-01	Splice Sleeve for WW-543	
(hmm>	#10 X 1" PPH Tek	